
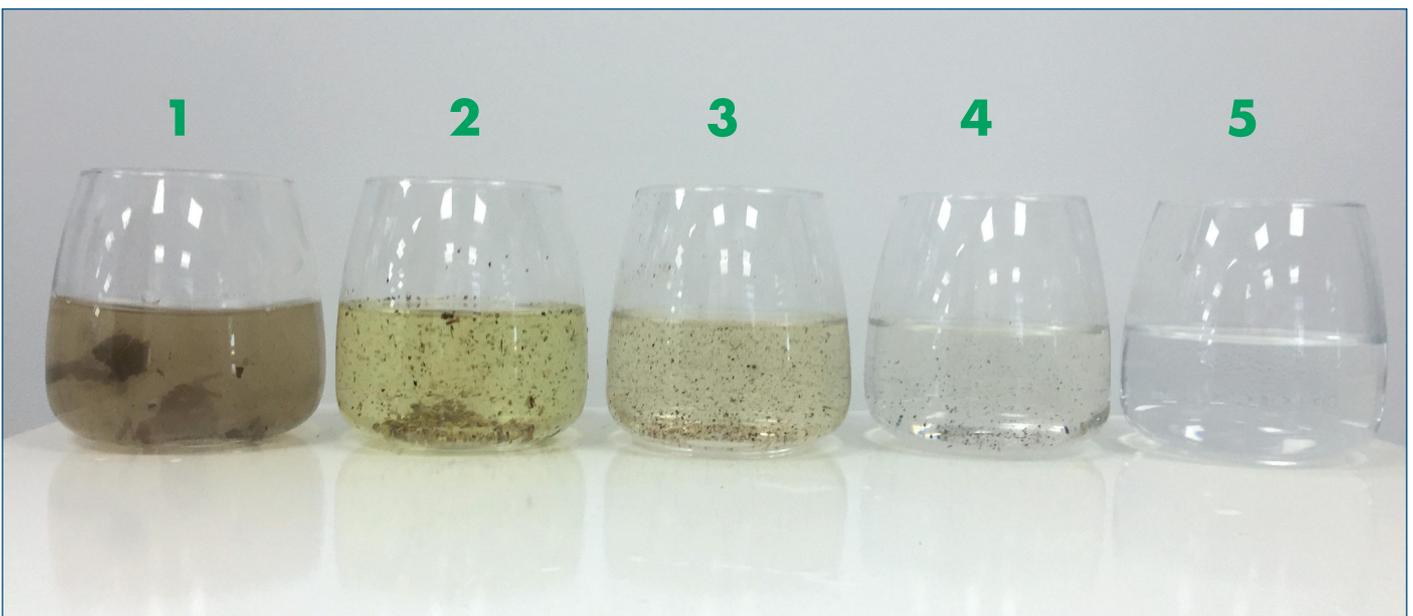


Normen drinkwater HyCare

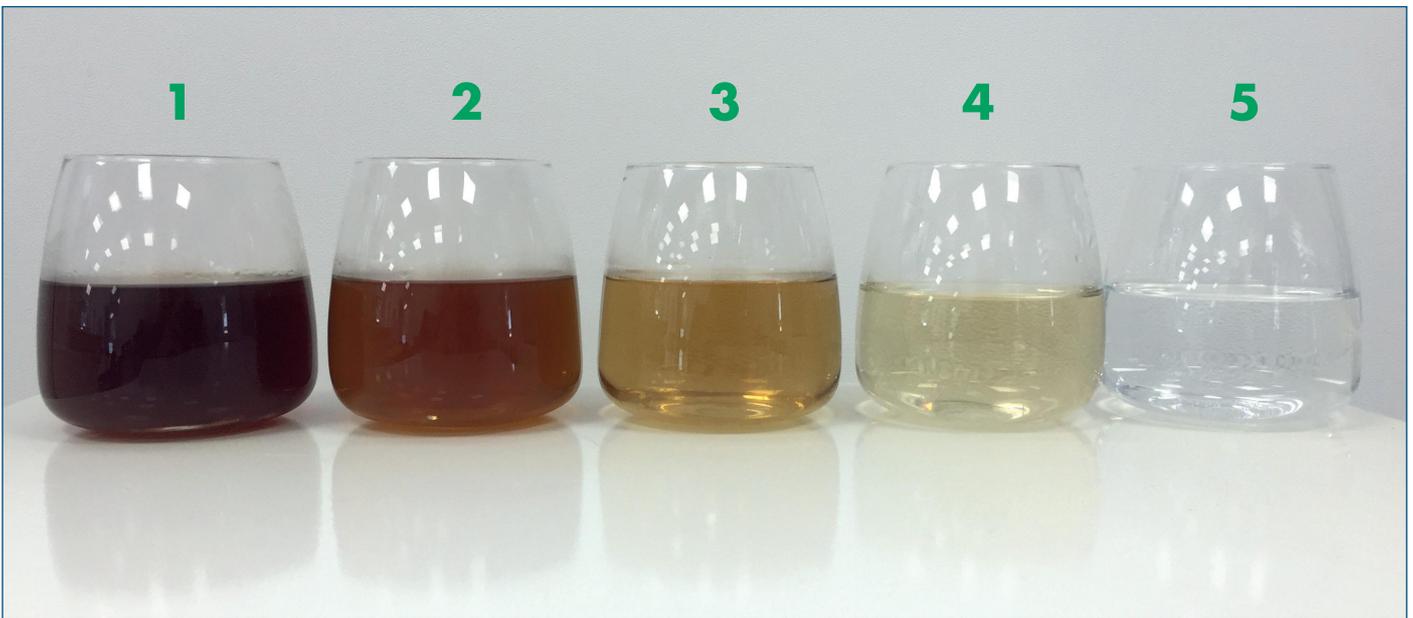

Varkens

Parameter	Norm Goed	Norm ongeschikt	Waarden klant
Kleur	5	<=3	
Sediment	5	<=3	
Geur	Geurloos	Sterke geur	
pH	5 – 8,0	<4 & >9	
Ammonium (mg/l)	<1,0	>2,0	
Nitriet (mg/l)	<0,10	>1,0	
Nitraat (mg/l)	<100	>200	
Chloride (mg/l)	<250	>2000	
Natrium (mg/l)	<400	>800	
Sulfaat (mg/l)	<150	>250	
Ijzer (mg/l)	0,20	0,20	
Mangaan (mg/l)	0,10	0,10	
Hardheid (°dH)	<15	>25	
Totaal kiemgetal (kve/ml)	<100	>1000	
E. Coli (kve/ml)	Afwezig	>10	
Gisten (kve/ml)	<10	>100	
Schimmels (kve/ml)	<10	>100	